

A LEVEL 1 REPORT

ON THE FILLING

AT

HONOUR VILLAGE ESTATE

STAGE 8

CLYDE NORTH

2210348-100

TABLE OF CONTENTS

1. SITE DESCRIPTION:.....	3
2. PREVIOUS GEOTECHNICAL INVESTIGATIONS ON THE SITE:.....	3
3. DOCUMENTS SUPPLIED:	4
4. SITE PREPARATION REQUIREMENTS:.....	4
4.1 Site Stripping Requirements	4
4.2 Subgrade Assessment Requirements.....	4
5. REQUIREMENTS FOR THE PLACEMENT OF COMPACTED EARTH FILL:	4
5.1 Layer Thickness.....	4
5.2 Density Requirements	4
5.3 Moisture Content Requirements	4
5.4 Type of Tests Required	4
5.5 Number of Test Required	4
6. THE PERIOD OVER WHICH THE WORK WAS CARRIED OUT	4
7. EQUIPMENT USED:.....	5
8. EARTHWORKS SUMMARY:.....	5
8.1 Description of Earthworks Undertaken	5
8.2 Observation of Stripping and Site Preparation	5
8.3 Observation of Fill Materials	5
8.4 Tests Carried Out	5
8.5 Results of Testing.....	5
9. CONCLUSION:	6

APPENDIX A

TEST REPORTS & PLANS

REPORT No : 2210348-100

CLIENT : Todd Hyland
Senior Development Manager
todd.hyland@frasersproperty.com.au
c/- Australand Residential No 156 Pty Ltd
PO Box 3307
Rhodes NSW 2138

AUTHORIZED BY : Mr Todd Hyland

PROJECT LOCATION : Honour Village Estate – Stage 8, CLYDE NORTH

COMMISSION : Carry out all appropriate inspections and testing at the site to ensure that the fill is placed in accordance with the project specifications. At the end of the works, compile a report – LEVEL ONE TYPE REPORT AS PER SECTION 8 OF AS3798 – setting out the findings of all inspections, instructions issued and test results, including any failure results and what action was taken to rectify any failure.

1. SITE DESCRIPTION:

Stripping and placement of compacted fill in Stage 8.

2. PREVIOUS GEOTECHNICAL INVESTIGATIONS ON THE SITE:

Not Supplied

3. DOCUMENTS SUPPLIED:

Reeds Consulting - Site Plan - Ref: 22344P, Version N

4. SITE PREPARATION REQUIREMENTS:

4.1 Site Stripping Requirements

Fill area to be stripped of vegetation and topsoil prior to filling.

4.2 Subgrade Assessment Requirements

Any soft, weak or unstable areas of subgrade exposed to be removed.

5. REQUIREMENTS FOR THE PLACEMENT OF COMPACTED EARTH FILL:

5.1 Layer Thickness

Fill shall be placed in 300mm compacted layers.

5.2 Density Requirements

95% Standard compaction

5.3 Moisture Content Requirements

No moisture requirements specified.

5.4 Type of Tests Required

Compaction (AS1289 5.7.1 & 2.1.1)

5.5 Number of Test Required

Compaction: Minimum of 1 test per 500m³.

6. THE PERIOD OVER WHICH THE WORK WAS CARRIED OUT

Inspections and testing of the project was carried out between 01/10/2019 to 27/08/2021.

7. EQUIPMENT USED:

Excavator
Pad Foot Roller
Compactor
Dump Truck
Water Cart

8. EARTHWORKS SUMMARY:

8.1 Description of Earthworks Undertaken

Fill area was backfilled and compacted with onsite Pad Foot Roller or Compactor in 300mm layers.

8.2 Observation of Stripping and Site Preparation

Fill areas observed were excavated to the naturally occurring silty CLAY prior to the placement of fill.

8.3 Observation of Fill Materials

The fill material was a site derived silty CLAY

8.4 Tests Carried Out

A total of 4 compaction tests (Hilf Rapid Method) were undertaken on the compacted earth fill of which no test failed to achieve the specified compaction requirements.

8.5 Results of Testing

The compaction results show that compacted fill was placed and compacted at a density between 99.0% and 100.5% of AS1289 5.7.1 Standard Compaction.

9. CONCLUSION:

Civiltest carried out supervision, inspections and testing on this project in a manner that would allow this level one type report to be completed as set out in Section 8 of AS3798 "Guidelines on earthworks for commercial and residential developments".

With the observations made during the works and the results of tests carried out, it has been concluded, as far as can be determined, that the contractor Bayport Civil Pty Ltd has met the requirements of the project.

A handwritten signature in dark ink, appearing to be 'PM', with a long horizontal flourish extending to the right.

Phil Morgans
CIVILTEST PTY LTD

15 June 2022

REF: PM/ik

Material Test Report

Report Number: 1190228-96
Issue Number: 2 - This version supersedes all previous issues
Reissue Reason: Plan Added
Date Issued: 08/10/2019
Client: Australand Residential No 156 Pty Ltd
Level 9, 484 St Kilda Road, MELBOURNE, VIC 3004,
Project Number: 1190228
Project Name: HONOUR VILLAGE WETLANDS STAGE 2, CLYDE NORTH
Project Location: HONOUR VILLAGE WETLANDS STAGE 2, CLYDE NORTH
Work Request: 4296
Date Sampled: 01/10/2019 7:15
Dates Tested: 01/10/2019 - 04/10/2019
Sampling Method: AS1289 1.2.1 6.4 (b) - Sampling from layers in earthworks or pavement - compacted
Specification: Minimum 95% Standard Compaction

Civiltest Pty Ltd
Mitcham Laboratory
Unit 7/38 Thornton Crescent Mitcham Vic 3132
Phone: (03) 9874 5844
Email: scott.flood@civilttest.com.au
Accredited for compliance with ISO/IEC 17025 - Testing




Approved Signatory: Scott Flood
Laboratory Manager
NATA Accredited Laboratory Number: 790

Compaction Control AS 1289 5.7.1 & 5.8.1 & 2.1.1					
Sample Number	192-4296A	192-4296B	192-4296C	192-4296D	192-4296E
Date Tested	01/10/2019	01/10/2019	01/10/2019	01/10/2019	01/10/2019
Time Tested	08:30	10:00	10:05	02:30	02:35
Test Request #/Location	Lots 802/803/804	Lots 805/806	Lots 538/539	Lot 807	Lot 537
Chainage (m)	**	**	**	**	**
Location Offset (m)	**	**	**	**	**
Layer / Reduced Level	700mm Below F.S	700mm Below F.S	700mm Below F.S	400mm Below F.S	400mm Below F.S
Thickness of Layer (mm)	300	300	300	300	300
Soil Description	CLAY sandy silty	CLAY sandy silty	CLAY sandy silty	CLAY sandy silty	CLAY sandy silty
Test Depth (mm)	275	275	275	275	275
Sieve used to determine oversize (mm)	19.0	19.0	19.0	19.0	19.0
Percentage of Wet Oversize (%)	0.0	0.0	0.0	0.0	0.0
Field Wet Density (FWD) t/m ³	1.96	1.97	1.95	1.99	1.99
Field Moisture Content %	23.5	25.7	25.5	25.7	25.1
Field Dry Density (FDD) t/m ³	1.59	1.57	1.56	1.58	1.59
Peak Converted Wet Density t/m ³	1.95	2.00	1.96	1.99	1.99
Adjusted Peak Converted Wet Density t/m ³	**	**	**	**	**
Moisture Ratio % (AS 1289.5.4.1)	93.0	90.5	91.5	88.5	91.5
Adjusted Moisture Ratio % (AS 1289.5.4.1)	**	**	**	**	**
Moisture Variation (Wv) %	1.5	2.5	2.0	3.0	2.0
Adjusted Moisture Variation %	**	**	**	**	**
Hilf Density Ratio (%)	100.5	99.0	99.5	100.0	99.5
Compaction Method	Standard	Standard	Standard	Standard	Standard

Moisture Variation Note:

Positive values = test is dry of OMC
Negative values = test is wet of OMC

PLAN – LOCATION OF TEST SITES: *Honour Village Wetlands Stage 2 CLYDE NORTH*

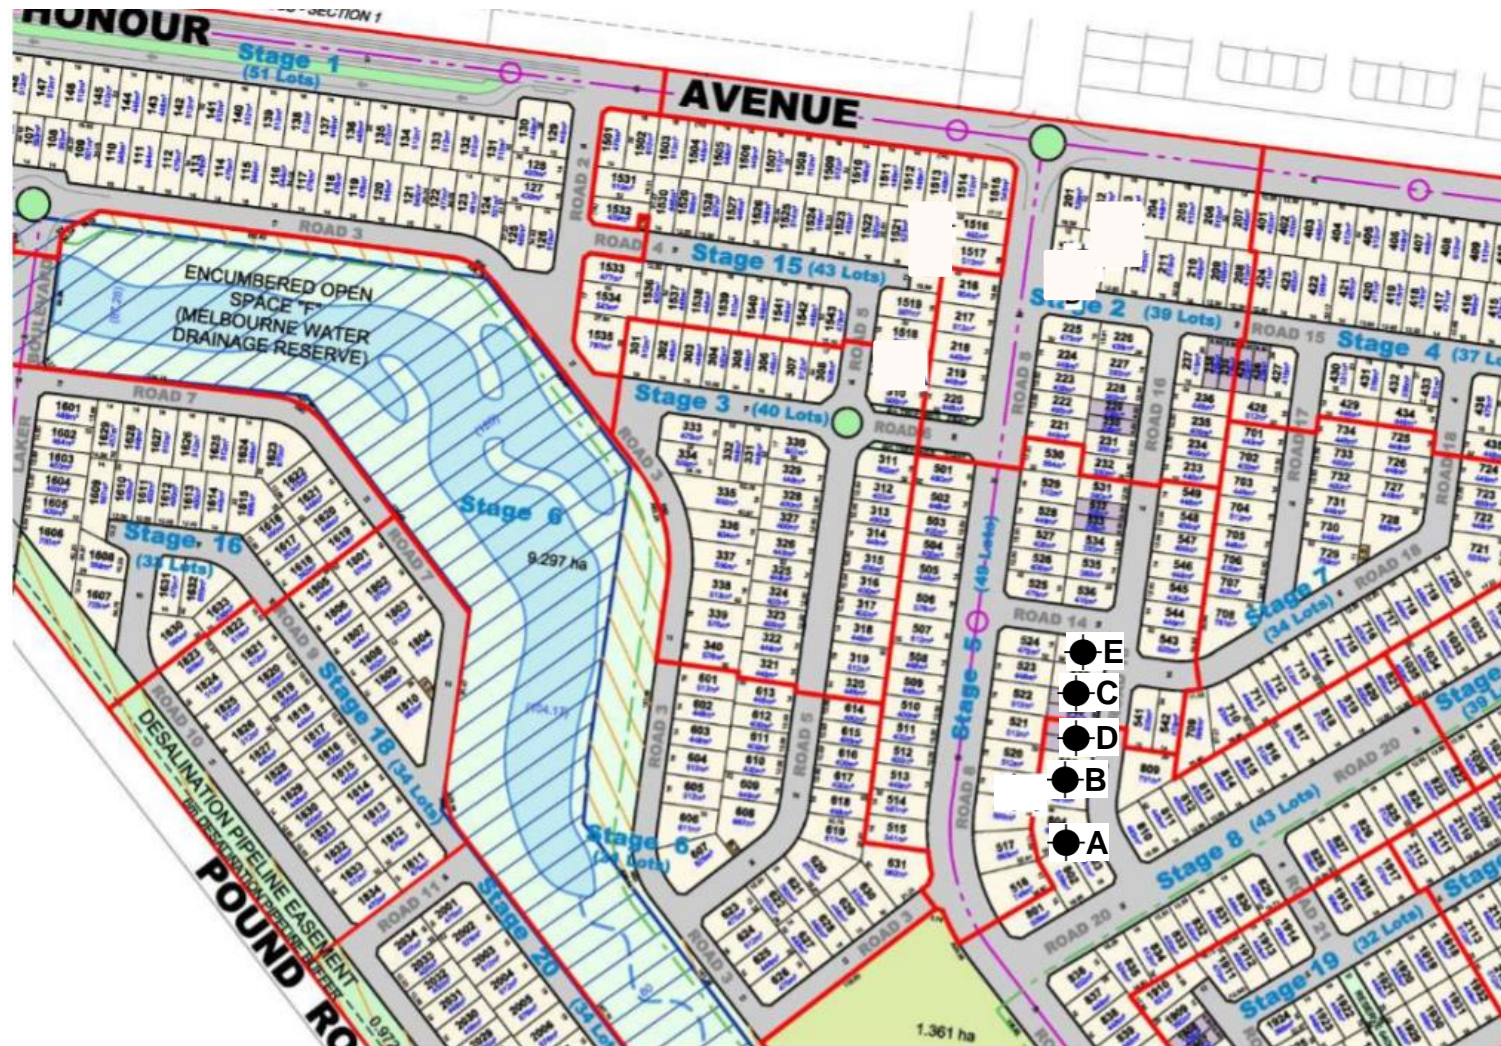

● Denotes Test Locations

THIS SKETCH IS NOT INTENDED TO BE AN ACCURATE DEPICTION OF THE NUMBER, SIZE OR LOCATION OF TREES AND/OR SHRUBS

NOT TO SCALE

Material Test Report

Report Number: 2210348-14
Issue Number: 1
Date Issued: 01/09/2021
Client: Bayport Civil Pty Ltd
55 Colemans Road, CARRUM DOWNS VIC 3201
Contact: Drew
Project Number: 2210348
Project Name: Honour Village Estate, CLYDE NORTH
Project Location: Honour Village Estate, CLYDE NORTH
Work Request: 10996
Date Sampled: 27/08/2021 7:30
Dates Tested: 27/08/2021 - 30/08/2021
Sampling Method: AS 1289.1.2.1 6.4 (b) - Sampling from layers in earthworks or pavement - compacted
Specification: Minimum 95% Standard Compaction
Site Selection: Selected by Client
Location: Honour Village Estate, CLYDE NORTH
Material Source: Site Derived



Civiltest Pty Ltd
Mitcham Laboratory
Unit 7/38 Thornton Crescent Mitcham Vic 3132
Phone: (03) 9874 5844
Email: Phil.morgans@civiltest.com.au

Accredited for compliance with ISO/IEC 17025 - Testing



Approved Signatory: Phil Morgans
Branch Manager
NATA Accredited Laboratory Number: 790

Compaction Control AS 1289 5.7.1 & 5.8.1 & 2.1.1

Sample Number	212-10996A	212-10996B	212-10996C
Date Tested	27/08/2021	27/08/2021	27/08/2021
Time Tested	11:36	11:55	14:51
Test Request #/Location	Lot 805/806	Lot 1540	Lot 538/539
Chainage (m)	**	**	**
Location Offset (m)	**	**	**
Layer / Reduced Level	600 below FS	800 below FS	300 below Fs
Thickness of Layer (mm)	300	300	300
Soil Description	Mudstone	Mudstone	Mudstone
Test Depth (mm)	275	275	275
Sieve used to determine oversize (mm)	19.0	19.0	19.0
Percentage of Wet Oversize (%)	11	0	13
Field Wet Density (FWD) t/m ³	2.04	2.04	2.16
Field Moisture Content %	16.2	21.1	19.6
Field Dry Density (FDD) t/m ³	1.75	1.69	1.81
Peak Converted Wet Density t/m ³	**	2.06	**
Adjusted Peak Converted Wet Density t/m ³	2.05	**	2.09
Moisture Variation (Wv) %	**	-2.0	**
Adjusted Moisture Variation %	1.5	**	-0.5
Hilf Density Ratio (%)	99.5	99.0	103.0
Compaction Method	Standard	Standard	Standard
Report Remarks	**	**	**

Moisture Variation Note:

Positive values = test is dry of OMC

Negative values = test is wet of OMC

APPENDIX A

TEST REPORTS & PLAN